


NOTE:

PROVIDE 6" MINIMUM CRUSHED STONE CRADLE UNDER PIPE IN ROCK AREAS AND WHERE REQUIRED DUE TO TRENCH AND SOIL CONDITIONS.

STORM SEWERS & D.I.P. WATER MAIN

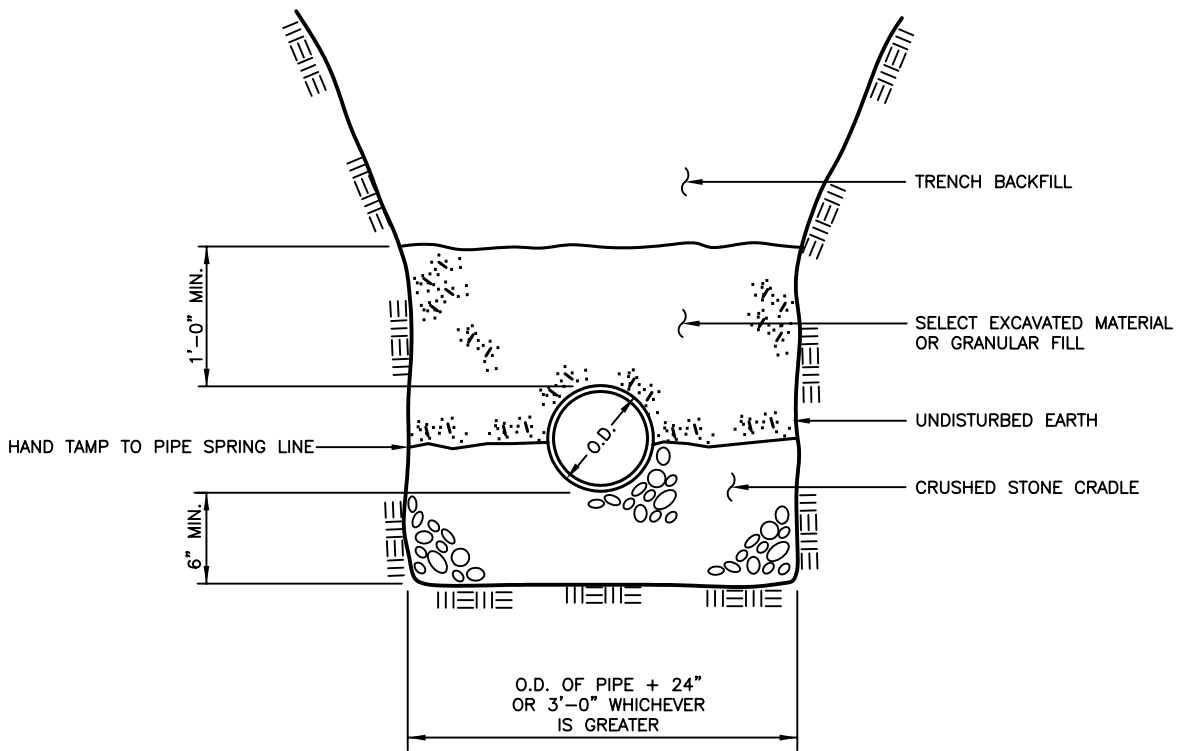

PVC WATER MAIN & SANITARY SEWERS

PIPE BEDDING DETAILS

**SNIEDZE ASSOCIATES, CONSULTING ENGINEERS
CANANDAIGUA, NEW YORK**

SCALE: 3/4" = 1'-0"

MAY 2007

TR-1